
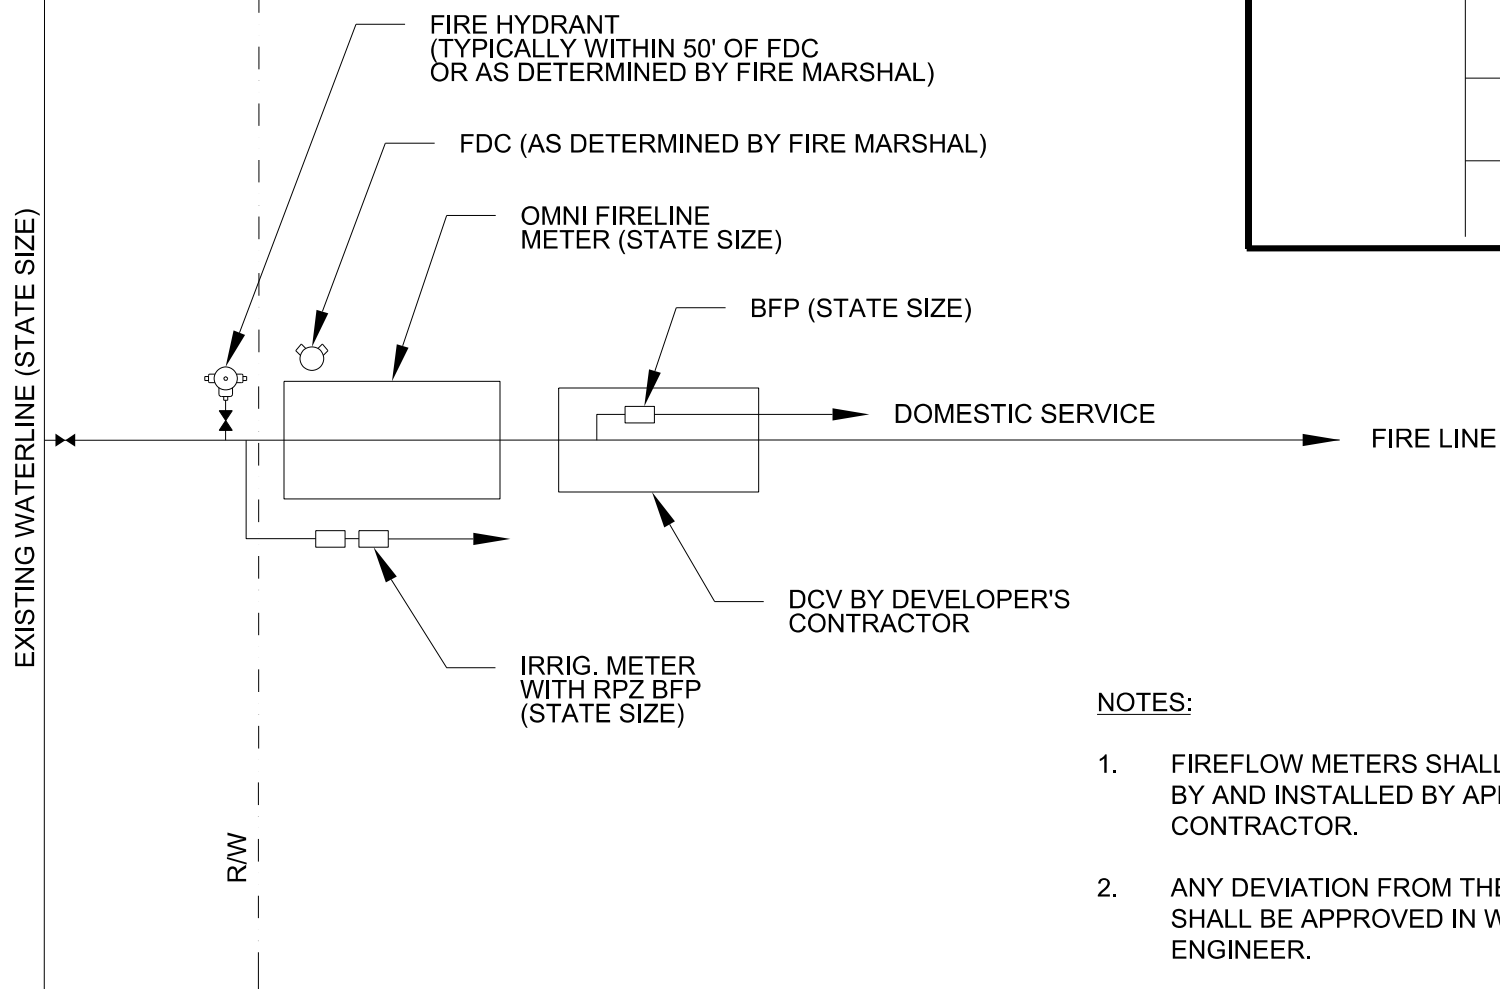


ALTERNATE CONFIGURATIONS

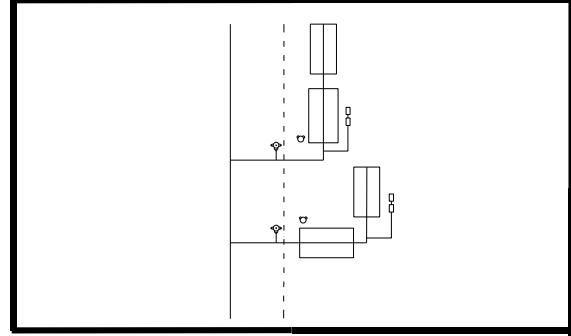

NOTES:

1. FIREFLOW METERS SHALL BE PROVIDED BY AND INSTALLED BY APPROVED LICENSED CONTRACTOR.
2. ANY DEVIATION FROM THESE STANDARDS SHALL BE APPROVED IN WRITING BY THE HCWA ENGINEER.

HENRY COUNTY WATER AUTHORITY



TYPICAL COMMERCIAL / INDUSTRIAL METER CONFIGURATIONS

REVISED: 01/30/2015

SCALE: N.T.S.

DETAIL NO.

W23